
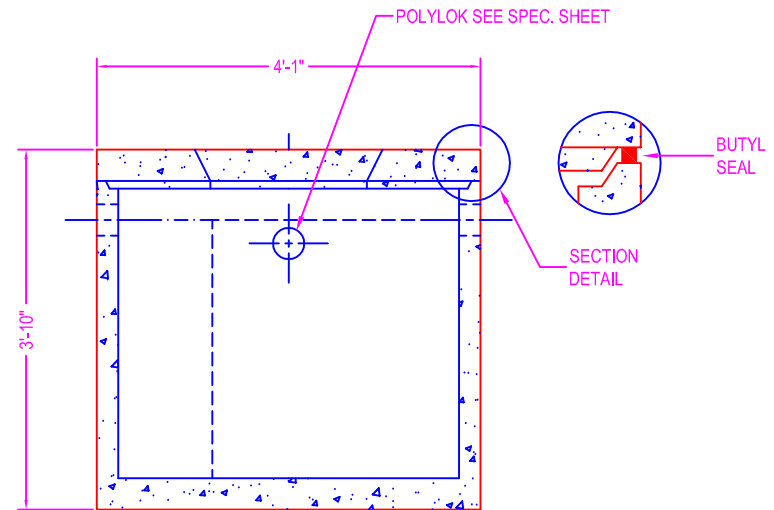



# CHLORINE DISPENSING TANK

3-Inlets  
1-Outlet

## NOTES:

CAPACITY: 500 Gallons  
 CONCRETE: 5000 psi @ 28 days  
 POLYPROPYLENE FIBERS  
 REF.: #3 rebar  
 PIPE CONNECTS: Polylok

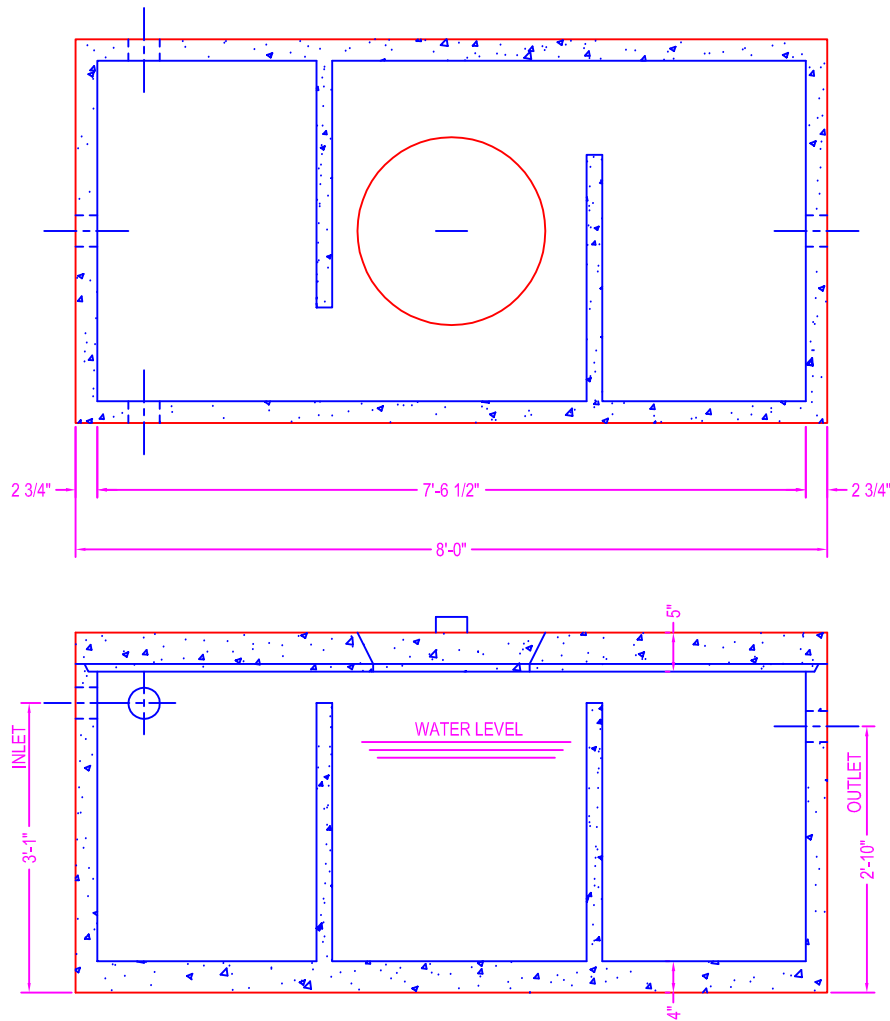

 <p>Zeiser                  Wilbert                  VAULT, INC.                  CONCRETE PRODUCTS</p>	750 Howard Street Elmira, NY 14904 Fax: (607) 737-0291 Phone: (607) 733-0568 1-800-472-4335	Title: CHLORINE DISP. TANK	Drawn By: JPS
		Scale: Not To Scale	Drawing No.: 1075
		Date: 1-6-00	